


Note: 12" WMM to be installed approximately 5 feet inside R/W.
Final alignment to be adjusted as necessary to avoid conflict and damage to existing utilities, trees, signs, cable boxes, etc.

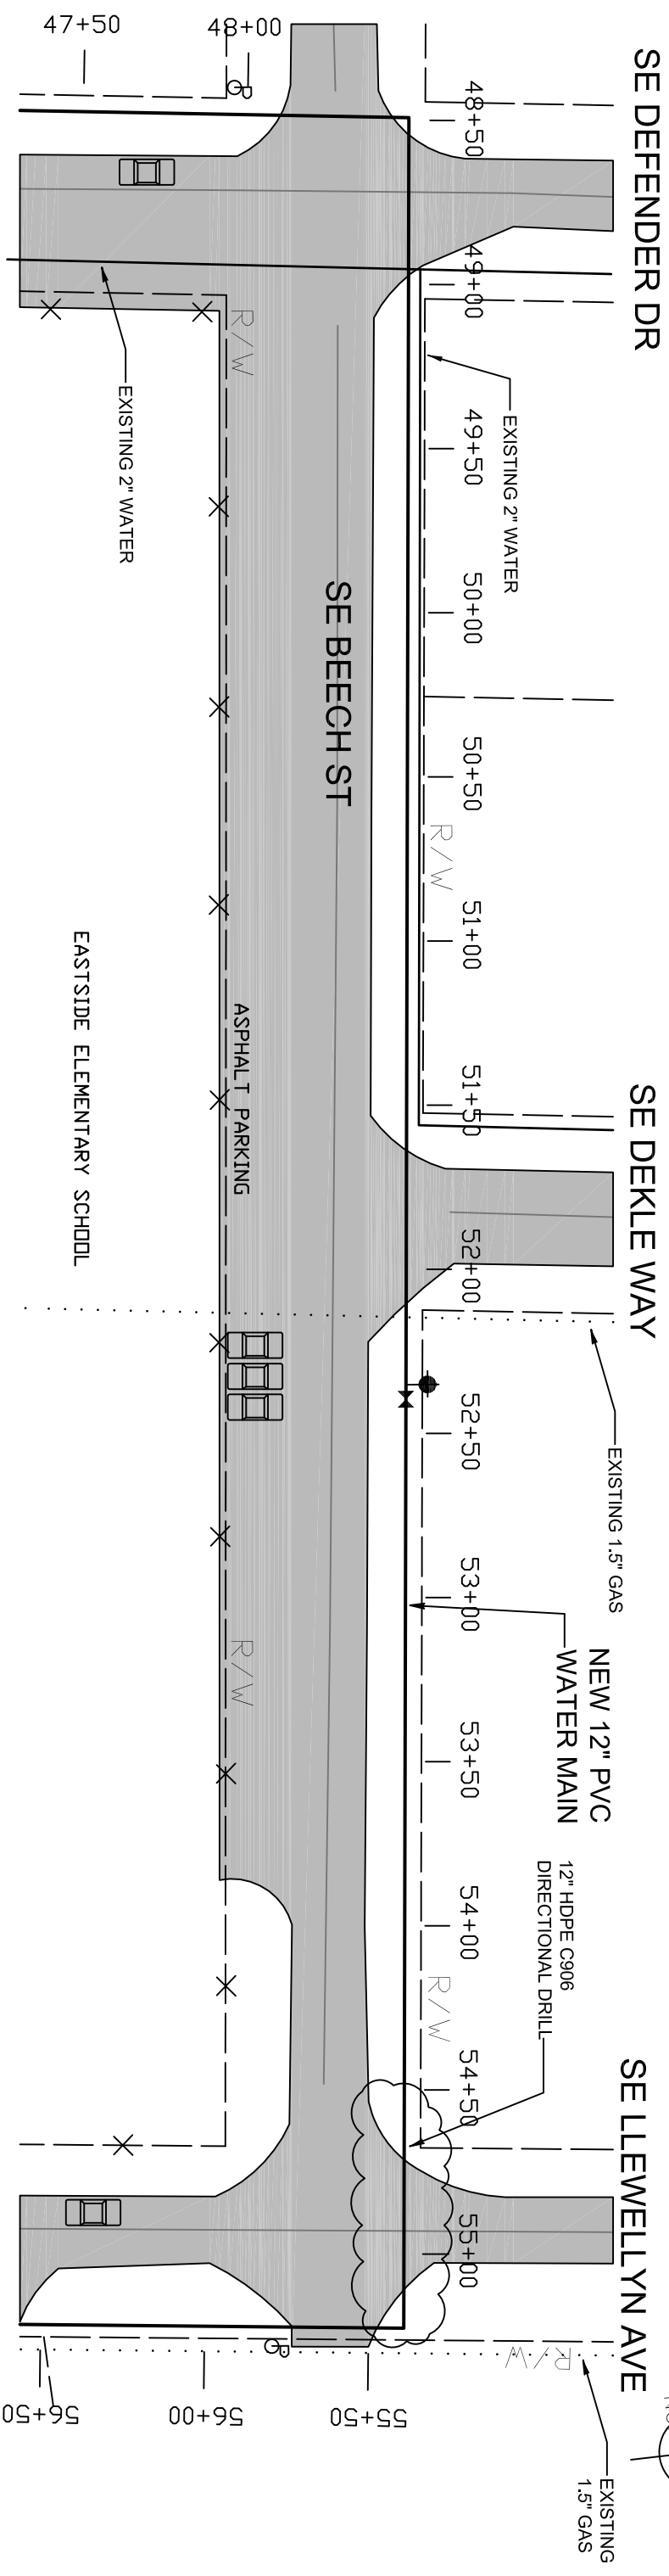

108																					108
106																					106
104		SE BEECH ST		SE DEFENDER DR																	104
102										36" MIN COVER											102
100																					100
98																					98
96																					96
94										NEW 12" PVC WATER MAIN											94
92																					92
90																					90

48+00	48+50	49+00	49+50	50+00	50+50	51+00	51+50	52+00	52+50	53+00	53+50	54+00	54+50	55+00
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------

CITY OF LAKE CITY, FLORIDA
WATER DISTRIBUTION SYSTEM

12" PVC WATER MAIN - EAST RADIAL
SE BEECH ST

Henry A. Sheldon, P.E.
11611 SW 89th Street
Gainesville, Florida 32608

SHEET: 13

SCALE 1" = 50'

